Sewer Pipe Summary				
Design Point Begin	Design Point End	Developer Pipe Size	City Pipe Size	Length (ft)
DP1	DP2	0	21	1,624
DP2	DP3	10	21	689
DP3	DP4	10	21	1,236
DP4	DP6	12	21	2,361
DP5	DP5A	8	8	1,689
DP5A	DP6	8	12	2,798
DP6	DP7	12	24	4,451
DP7	DP8	12	27	1,267
DP8	DP9	15	27	942
DP9	DP10	15	27	2,234

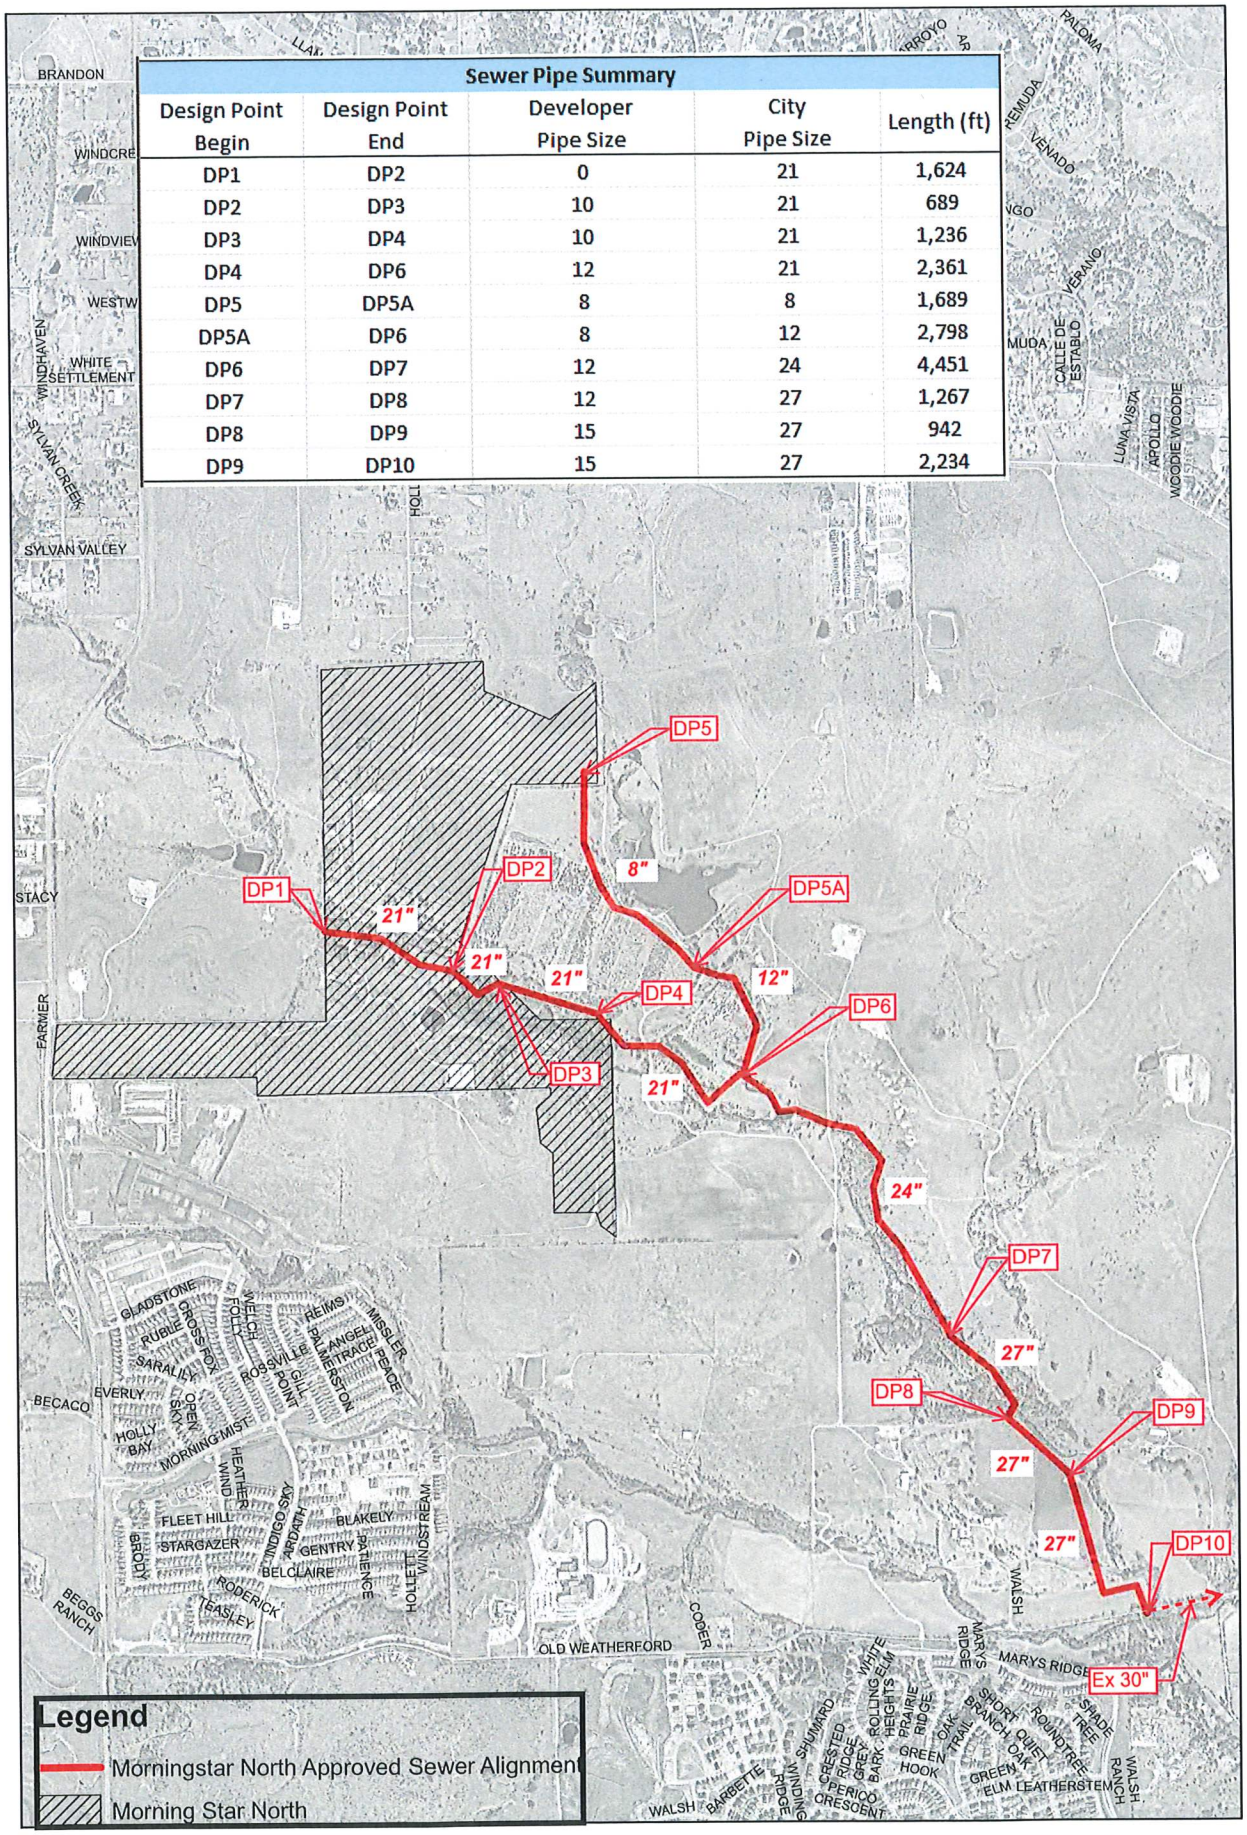

12/11/2023

COPYRIGHT 2023 CITY OF FORT WORTH
UNAUTHORIZED REPRODUCTION IS A VIOLATION OF APPLICABLE LAWS.

THIS DATA IS TO BE USED FOR A GRAPHICAL REPRESENTATION ONLY. THE ACCURACY IS NOT TO BE TAKEN / USED AS DATA PRODUCED FOR ENGINEERING PURPOSES OR BY A REGISTERED PROFESSIONAL LAND SURVEYOR. THE CITY OF FORT WORTH ASSUMES NO RESPONSIBILITY FOR THE ACCURACY OF SAID DATA

Exhibit A - Morningstar North Sewer

FORT WORTH WATER

0 550 1,100 2,200 Feet

N